



, Saif Haytham
2197596
Unknown
21-Aug-24



dallah hospital
Kingdom of Saudi Arabia
الرياض 87833
29995555

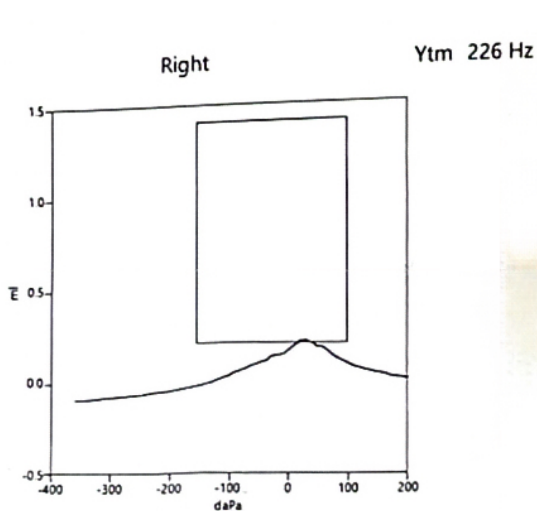

Tymp			Sweep daPa/sec		ECV	Peak daPa ml		Width daPa	Type
1	226 Hz	Y	←	600/200	0.5	30	0.20	N/A	

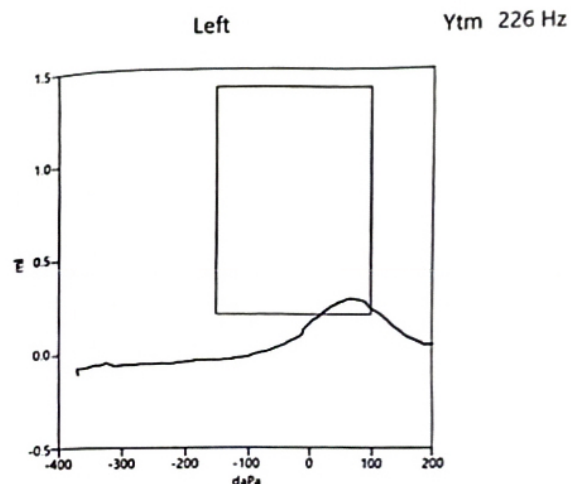

Tymp			Sweep daPa/sec		ECV	Peak daPa ml		Width daPa	Type
1	226 Hz	Y	←	600/200	0.6	70	0.30	N/A	

Ipsi: Stim R Rec R Contra: Stim L Rec R

Reflex Threshold


Stimulus Level	Ipsilateral	R	Contralateral	R
250				
500				
1000				
2000				
4000				
dB HL				
mmho				
daPa				

Ipsi: Stim L Rec L Contra: Stim R Rec L

Reflex Threshold

Stimulus Level	Ipsilateral	L	Contralateral	L
250				
500				
1000				
2000				
4000				
dB HL				
mmho				
daPa				

TYMP:
Type A, bilaterally



Examiner

AUDIOLOGY REPORT

Signed By: _____



DHMD238

License Number

21 AUG 2024

Signed On Date: _____